


Radon Pipe Rough-in Detail

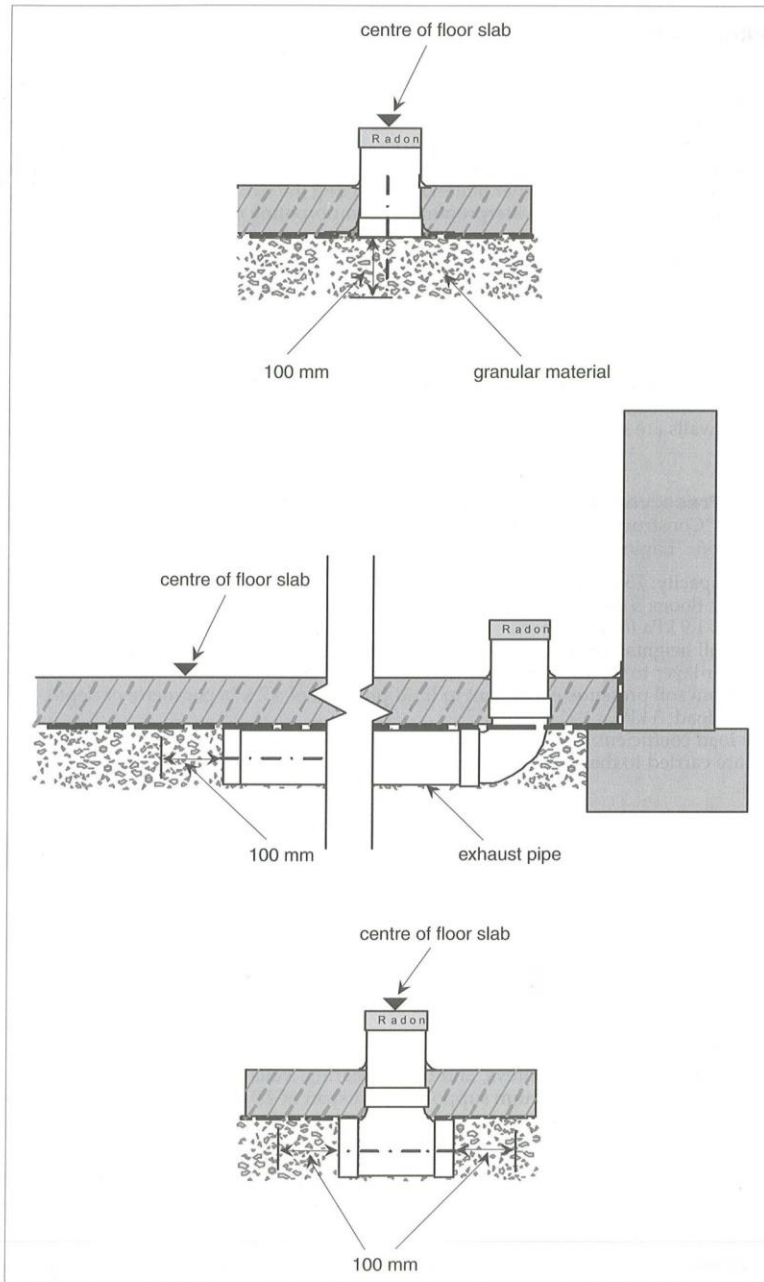

As part of the Soil Gas Control methods listed under Section 9.13.4 of the National Building Code, Rough-in for a subfloor depressurization system is required to allow for a future Radon extraction system if the need arises. Pipe is to be 100mm (4") ABS or PVC and installed within the gravel layer as shown in the detail.

This pamphlet has no legal status and cannot be used as an official interpretation of the various codes and regulations currently in effect.

Revised 2/27/15

City Of Summerside-Technical Services